

Interests of using a regional model to forecast wind power production

Doutreloup S. ; Fettweis X. ; Erpicum M.

Laboratory of Climatology, Department of Geography, University of Liège, Belgium, s.doutreloup@ulg.ac.be. (Ph. D. Student - Researcher)

Abstract

European policies have decided to reduce the greenhouse gas emissions of 20% and to reach 20% of renewable power production by 2020. Increasing wind power is one of the numerous solutions to reach these goals. However, this kind of energy production depends on the meteorological conditions and gives it an intermittent behaviour. The wind speed variations cause voltage and frequency fluctuations that are unacceptable for the power grid. Therefore, forecasting production will become essential with the aim of integrating this kind of energy production into the power grid.

We compare two kinds of models : A global one and a regional one. The first model using the GFS outputs (0,5° and 3h) is not precise enough in space and time to correctly forecast the wind speed in punctual wind farms. That is why we apply some specific tunings on these forecasts. These tunings depend on the air density, the wind direction and the stability of the air mass.

The second model using the WRF outputs (4km and 15min) runs over the Belgian territory. Initial conditions are forced by the GFS outputs at 0.5° and WRF computes a physical based spatio-temporal downscaling of the meteorological variables. Some slight tunings are also needed to adjust the wind power forecasts by comparison to the wind power observations.

The interests of using a regional model are : The outputs are available in a precise resolution, thus the errors created by the spatial and temporal resolution of GFS are decreased, the high production events are successfully forecasted, the roughness rose is not needed and the WRF model are configurable to adapt the forecasts the best as possible to the wind farms.

1. Contexts

The climate context

It is now almost certain that our excessive consumption of fossil fuels, accounting for 85% of anthropogenic emissions of CO2 significantly influence our climate (IPCC, 2007a).

The energy context

In addition, our heavy dependence on these fossil fuels leads to a rapid decline in their reserves (IPCC, 2007b), an increase of its extraction costs and thus a rise of its price.

Policies responses

European policies have decided to reduce the greenhouse gas emissions of 20% and to reach 20% of renewable power production by 2020. Increasing wind power is one of the numerous solutions to reach these goals.

2. Issue of wind energy

The problematic of the wind energy is its intermittent production. Indeed, this kind of energy is dependent on the weather conditions. This implies :

- If the wind speed drops, the electrical production also drops (event A on Fig.1)
- If there is no wind, there is no electrical production (event B on Fig.1)
- If the wind speed is too high, the electrical production stops (event C on Fig.1)

The important variations in short time scale of the electric production are unacceptable for the power grid. Therefore, to integrate the wind energy on the electric grid the most efficiently as possible we must forecast the wind production minimum one day in advance and every 15 minutes which is the time step of the electrical sector.

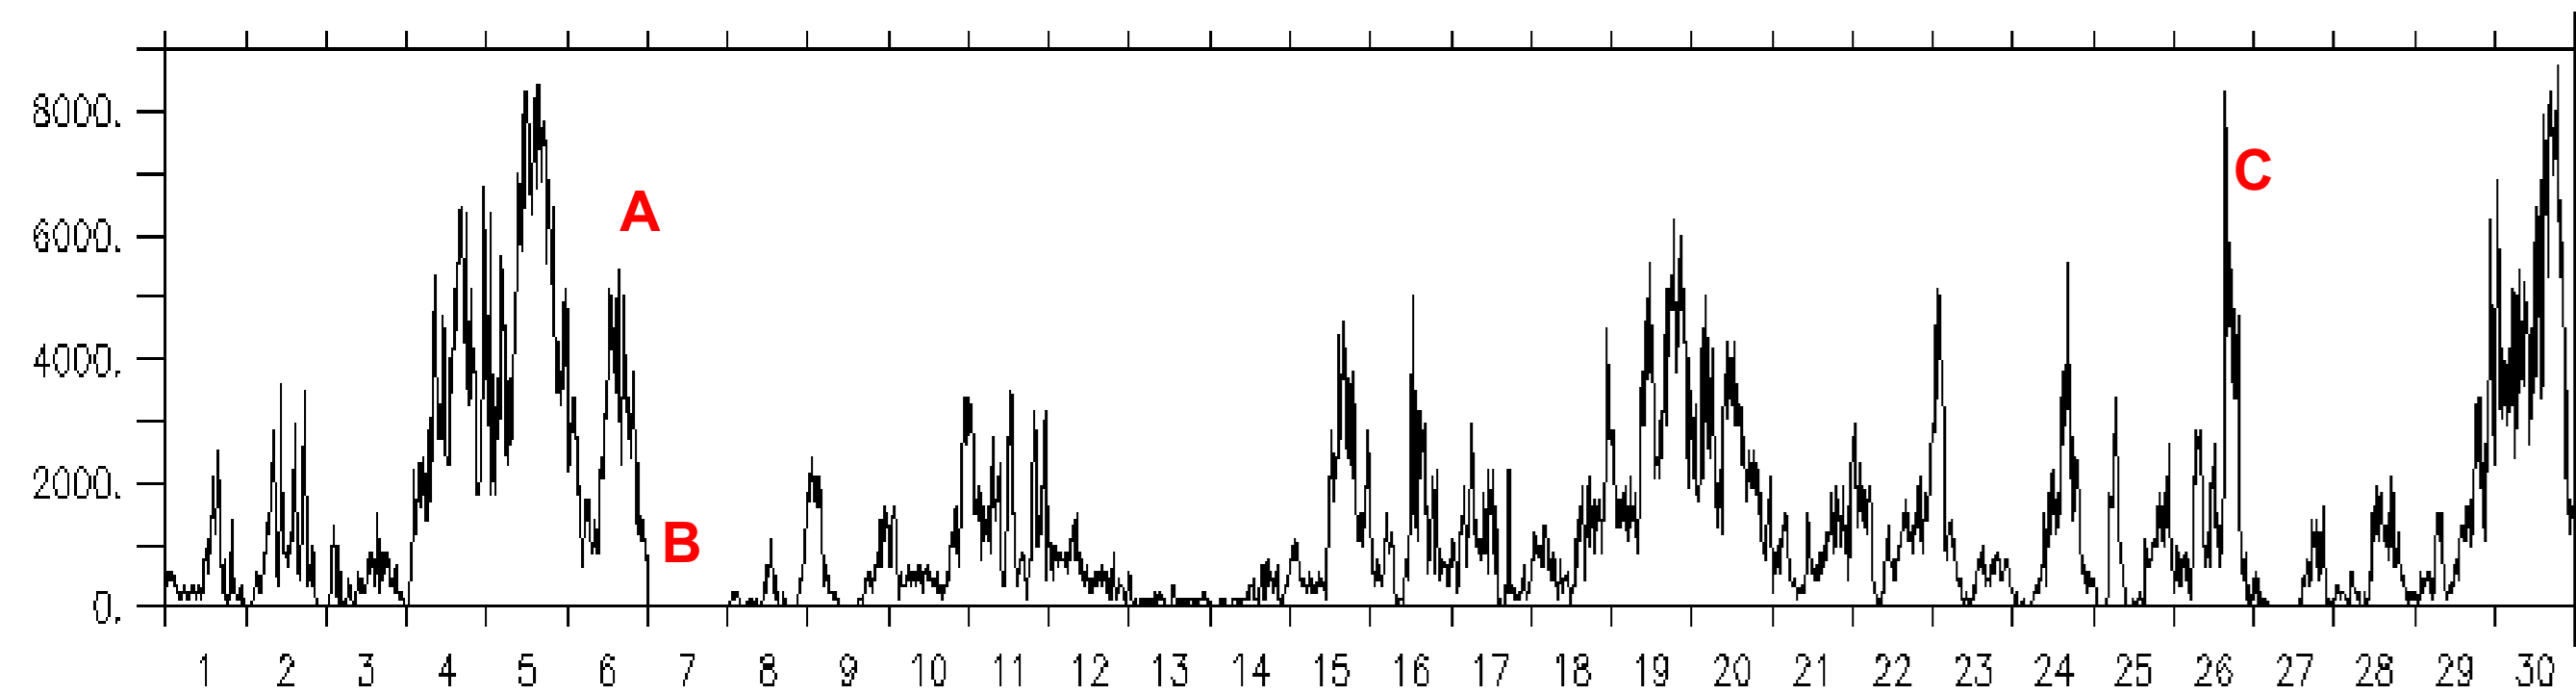


Fig. 1 : Example of observed production (in kWh) in a wind farm in Ardenne in Belgium on September 2010. X is a remarkable event.


References

- IPCC, 2007a: Climate Change 2007: Synthesis Report. Contribution of Working Groups I,II and III to the Fourth Assessment Report of the Intergovernmental Panel on Climate Change [Core Writing Team, Pachauri, R.K and Reisinger, A. (eds.)]. IPCC, Geneva,Switzerland, 104 pp.
- IPCC, 2007b : R.E.H. Sims, R.N. Schock, A. Adegbululgbé, J. Fenhann, I.Konstantinaviciute, W. Moomaw, H.B. Nimir, B. Schlamadinger, J. Torres-Martínez, C. Turner, Y. Uchiyama, S.J.V. Vuori, N. Wamukonya, X. Zhang, 2007: Energy supply. In Climate Change 2007:Mitigation. Contribution of Working Group III to the FourthAssessment Report of the Intergovernmental Panel on Climate Change [B. Metz, O.R. Davidson, P.R. Bosch, R. Dave, L.A. Meyer (eds)]. Cambridge University Press, Cambridge, United Kingdom and New York, NY, USA.
- NCAR, 2008. Weather and Research Forecast (WRF) version 3 modeling system user's guide, Mesoscale & Microscale Meteorology Division, National Weather for Atmospheric Research NCAR, s.l.: 2008.
- NOAA, 2010, Global Forecast System (GFS), National Weather Service, National Centers for Environmental Prediction Environmental Modeling Center, Maryland

3. Process to obtain wind power forecast


GFS (Global Forecast System) Model

The GFS model is a global model available over the world, with a spatial resolution of 0.5° and a temporal resolution of 3 h. The outputs are provided by the NOAA institute and thus are not configurable as we wish. To calculate the wind power production forecasts for tomorrow this model takes about 20 min. It downloads the GFS outputs, it calculates a linear interpolation every 15 min, it adjusts the wind speed with a roughness rose and other parameters, and finally, it transforms the wind speed into electric production.

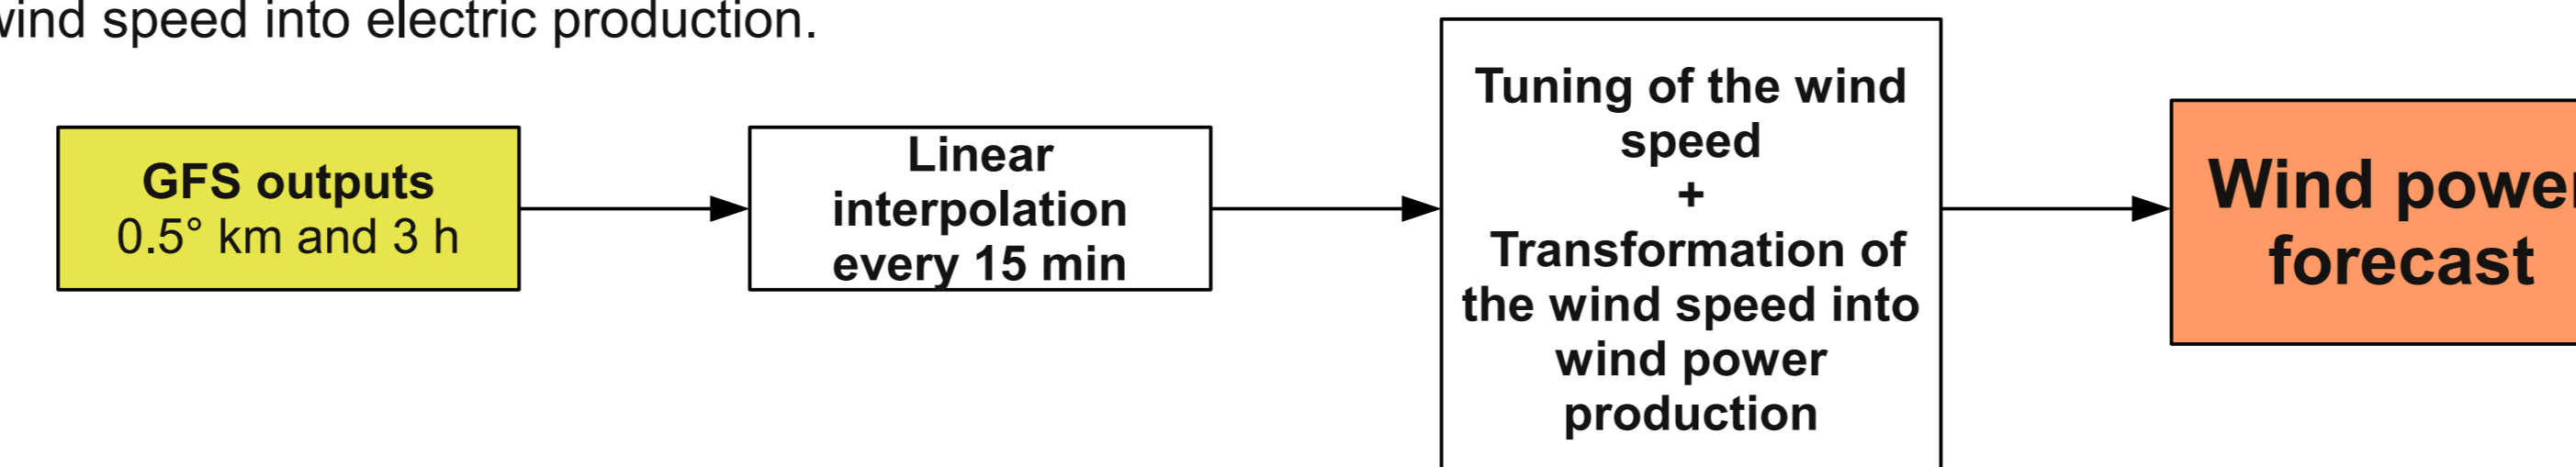

WRF (Weather Research Forecast) Model

The WRF model is a regional model provided by the NCAR/NCEP institute. The source codes are free and thus configurable as we wish. The WRF model used here is forced by GFS outputs, it is centred over Belgium and has a spatial resolution of 4 km and a temporal resolution of 15 min. To calculate the wind power production forecasts for tomorrow this model takes about 1 h. It downloads the GFS outputs and some static data, it calculates the regionalisation of the GFS outputs every 15 min and with a spatial resolution of 4 km, it slightly adjusts the wind speed, and it finally transforms the wind speed into electric production.

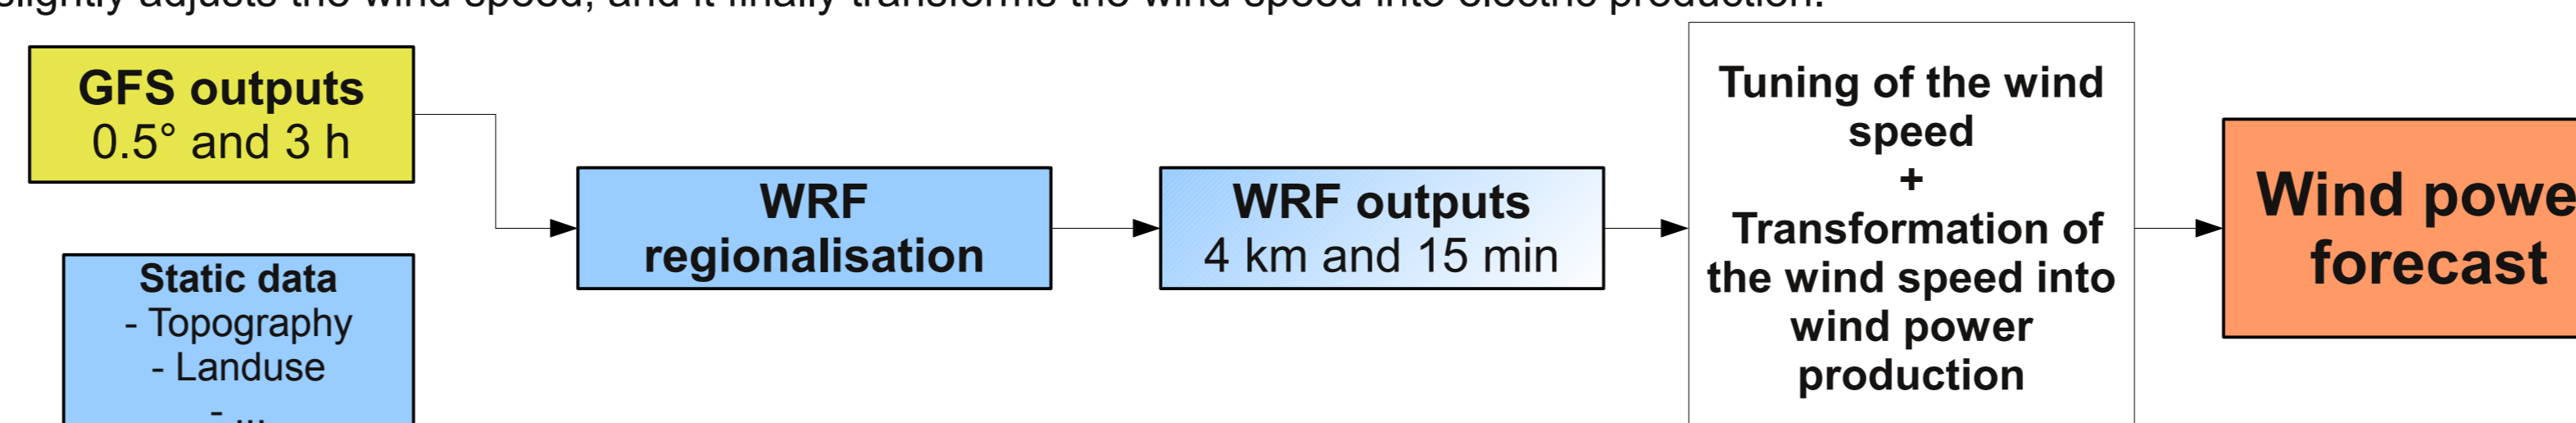

4. Analysis of a forecasted period

- A** : Production peaks correctly forecasted by WRF and not by GFS
- B** : Some remarkable events are not forecasted neither by GFS nor by WRF : Near a cold front or a convective area
- C** : Some wrong WRF forecasts also appear
- D** : One or more wind turbines halt for maintenance or security reasons

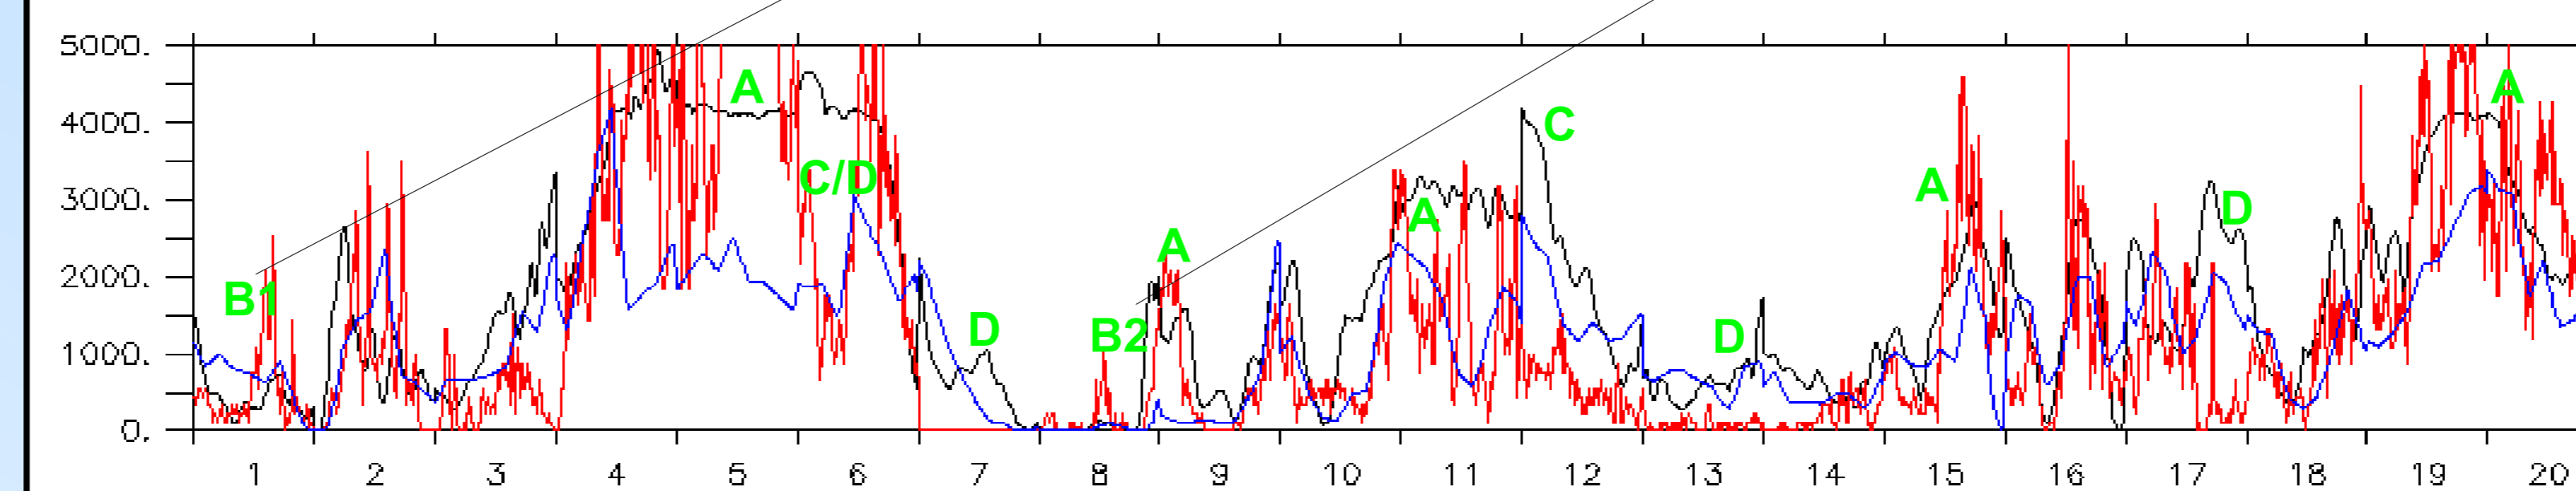
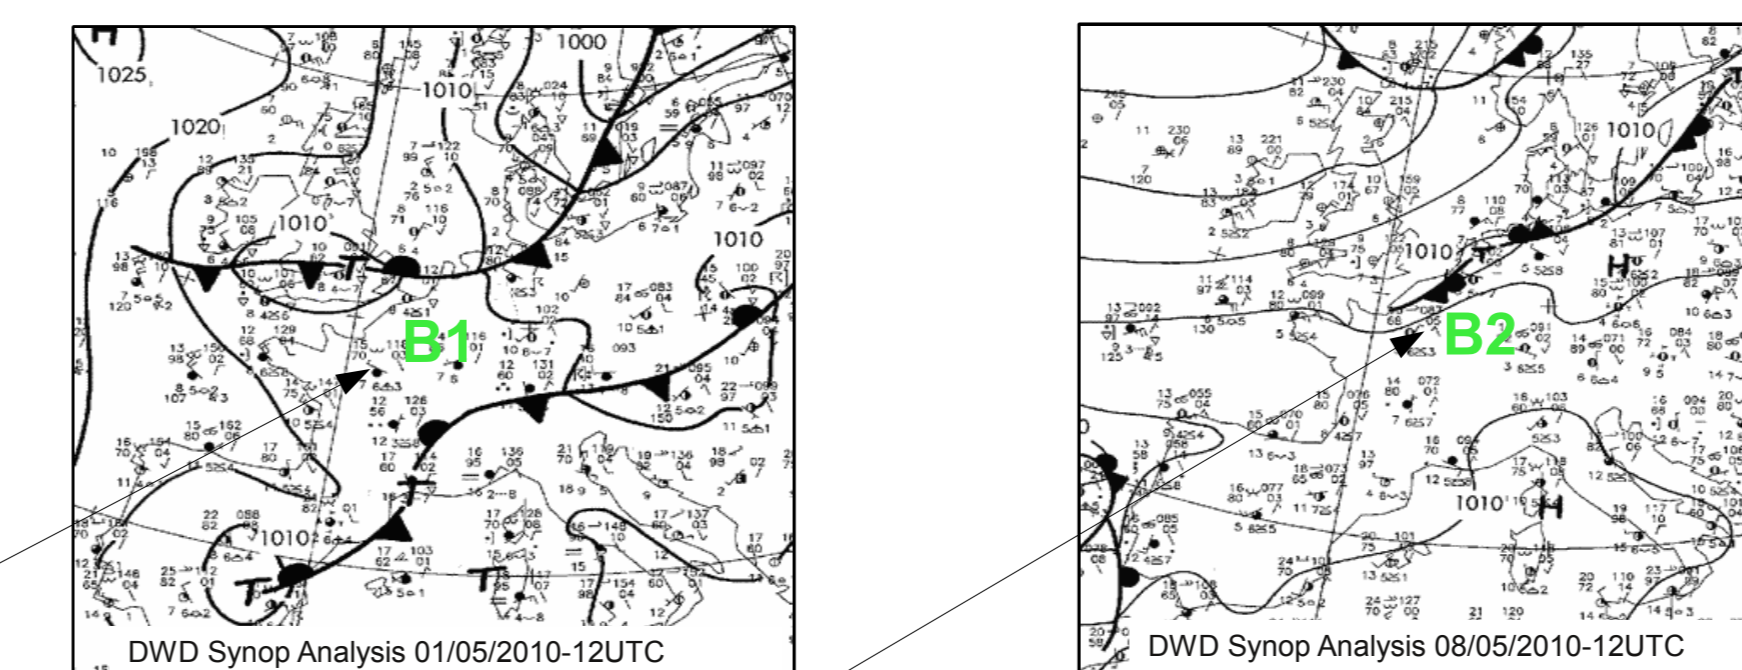


Fig 3 : Example of production observed (red line), GFS production forecast (blue line) and WRF production forecast (black line) in kWh for the first twenty days of May 2010. X is a remarkable note with a legend in the text.

5. Evaluation and results

Four evaluation indexes

$$\text{RMSE (Root Mean Square Error)} = \sqrt{\frac{1}{n} \sum (\text{obs} - \text{forecast})^2}$$

$$r^2 \text{ (Coefficient of determination)} = \frac{(\sum \text{obs forecast}) - (\sum \text{obs}) (\sum \text{forecast})}{\sqrt{(\sum \text{obs}^2 - (\sum \text{obs})^2) (\sum \text{forecast}^2 - (\sum \text{forecast})^2)}}$$

$$\text{PC (Percentage)} = \sum \left(1 - \text{ABS} \left(\frac{\text{obs} - \text{forecast}}{\text{obs}} \right) \right)$$

$$\text{PC40 (Conditioned percentage)} = \text{If } (\text{obs} \geq 40\% \text{ max prod}) \text{ then } \sum \left(1 - \text{ABS} \left(\frac{\text{obs} - \text{forecast}}{\text{obs}} \right) \right)$$

Results

From January 2010 to December 2010		
	GFS	WRF
RMSE	1619	1543
r ²	0,54	0,59
PC	0,41	0,42
PC40	0,6	0,68

From January 2010 to March 2010		
	GFS	WRF
RMSE	1923	1682
r ²	0,54	0,64
PC	0,44	0,49
PC40	0,64	0,7

From April 2010 to June 2010		
	GFS	WRF
RMSE	1353	1369
r ²	0,65	0,67
PC	0,37	0,41
PC40	0,56	0,7

From July 2010 to September 2010		
	GFS	WRF
RMSE	1479	1331
r ²	0,72	0,75
PC	0,4	0,42
PC40	0,52	0,62

From October 2010 to December 2010		
	GFS	WRF
RMSE	1721	1700
r ²	0,74	0,76
PC	0,43	0,4
PC40	0,63	0,68

Globally, we can consider that WRF model is better than GFS.

Sometimes, the PC index is better for the GFS model or very close to the PC index of WRF model but the PC40 index indicates that the forecasts are always better for the WRF model. Thus, the forecasts are better for the significant productions, which are more important for the producer of electricity and manager of electrical grid.

The results of the period from October to December 2010 do not look similar to the results of the other periods because the freezing conditions continuously stopped the wind turbine and thus the production.

6. Conclusions

Interests of using WRF :

- The **Outputs** are available at a resolution of **4km** and **15 min**. This precise resolution decreases the errors created by the spatial and temporal interpolation of the GFS outputs.
- The **high productions** are successfully forecasted and this events are more important for the users of these forecasts.
- The Influences of the **topography** are integrated in the WRF calculation, thus the roughness rose is not needed.
- The WRF model is **configurable** as we wish, thus We are independent on an other meteorological organism

Disadvantage of using WRF :

- WRF is forced by GFS outputs, this means that if the GFS forecasts are wrong, the WRF forecasts will also be wrong